



1685 CROSSTOWN BOULEVARD N.W. • ANDOVER, MINNESOTA 55304 • (763) 755-8700
FAX (763) 755-8923 • www.andovermn.gov

The Andover City Code Title 10-4-1 requires a septic tank be pumped and or inspected every 3 years. The State requires proper documentation that a permit was obtained and pumped by a licensed pumper. This rule is under the Individual Sewage Treatment Systems Program (ISTS) - Chapter 7080 – Section 0175 – Maintenance.

If septic pumping is not done every three years, please fill out this maintenance form and provide the name of septic pumper and last date of service.


ON-SITE SEWAGE DISPOSAL SYSTEM MAINTENANCE FORM

PLEASE COMPLETE IN FULL AND RETURN TO CITY OF ANDOVER – BUILDING
DEPARTMENT - Forms can be faxed or e-mail us for your convenience.

1. Today's Date _____
2. Homeowner's Name (PLEASE PRINT) _____
3. Address _____
4. Date of original septic installation (if known) _____
5. Date of last repair or reconstruction of system (if known) _____
6. Date of last septic tank pumping _____
7. Name of septic pumper who pumped tank _____
8. Date of inspection or any other information you can provide below:

Owner's Signature

Figure 18. Measuring sludge and scum in a septic tank.

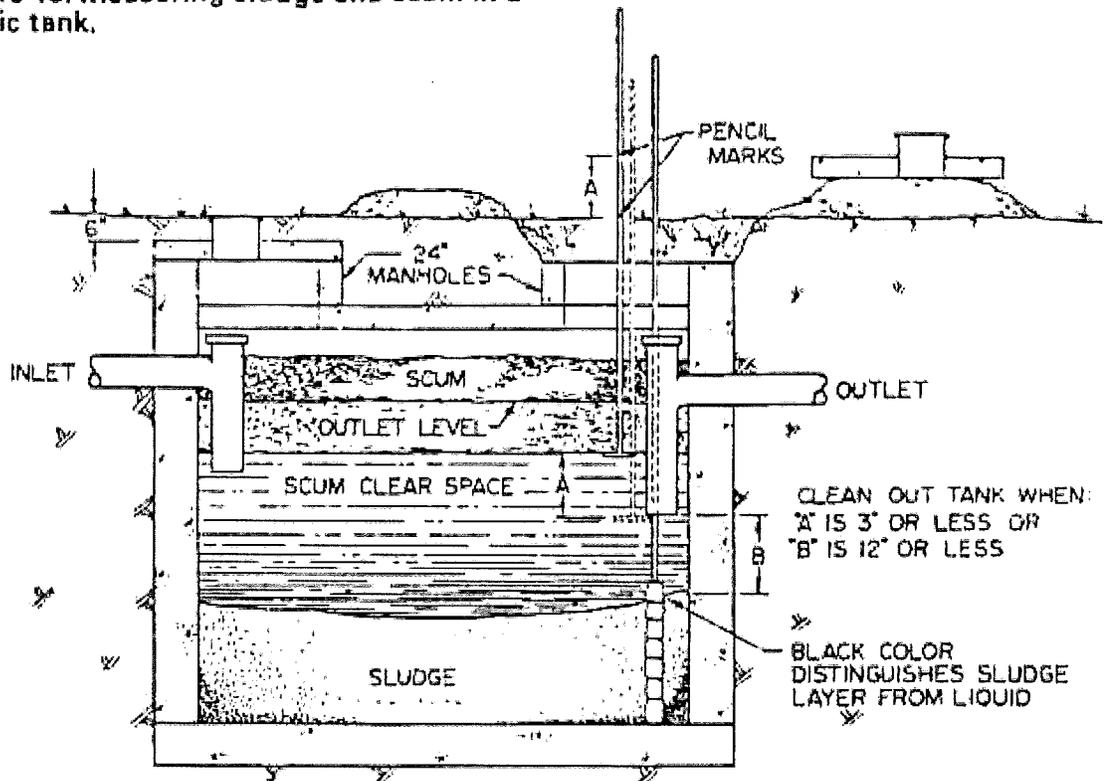

- 1. The scum is measured with a pole that has a 3" x 3" piece of plywood fastened to the bottom.**
- 2. The pole is forced through the scum mat and then raised until resistance from the bottom of the scum is felt. With the same tool, measure the distance to the bottom of the outlet device. If the layer and bottom of the outlet device are less than three inches apart, your septic tank should be pumped. See Figure.**